

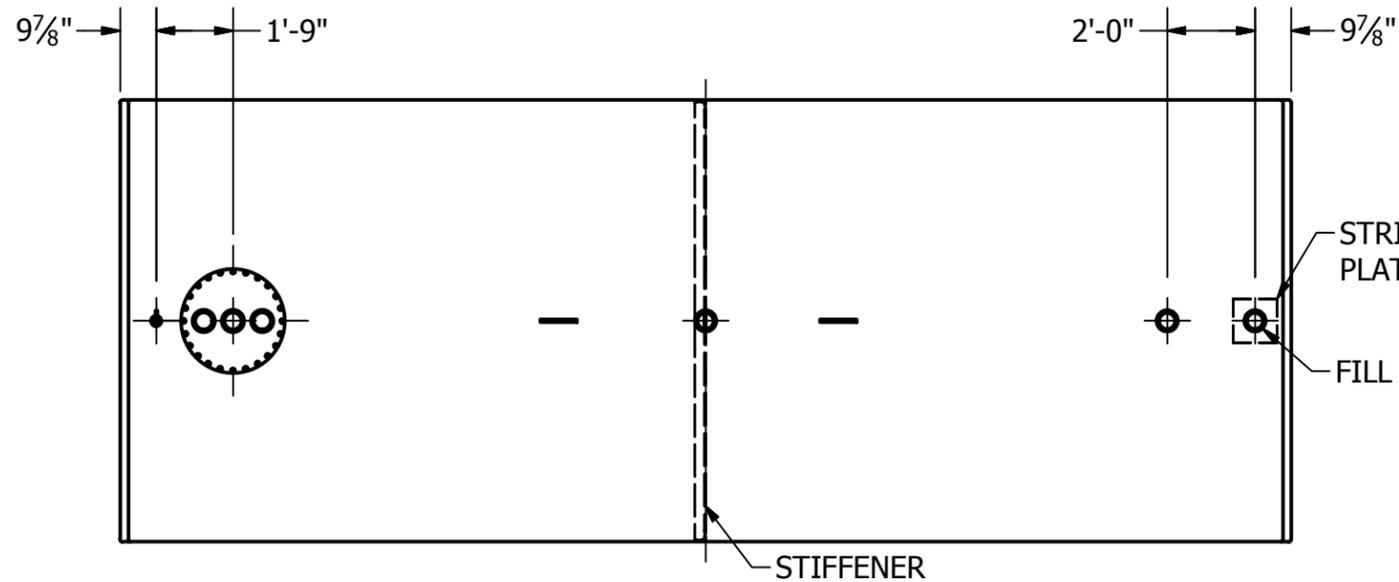


QC	LAYOUT	DIM. INSP.:	WELDER:	WELD INSP.:	COATING:	COAT. INSP.:	COMP. DATE:	HEAT #:
----	--------	-------------	---------	-------------	----------	--------------	-------------	---------

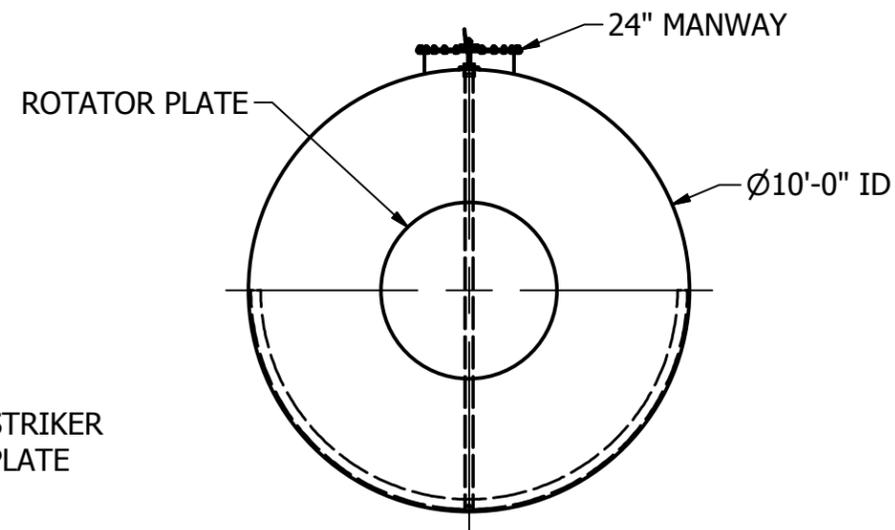

TANK SPECIFICATIONS	
ITEM	VALUE
Nominal Capacity (gal)	15000
Weight (lbs)	12010
Nominal Diameter (ft-in)	10'
Nominal Length (ft-in)	26'
Head Thickness (in)	1/4"
Shell Thickness (in)	1/4"
Manway	24" Steel,Buna Gasket,Nuts/Bolts
Fittings	4" FNPT Weld Flanges, Pilot, Curved 4" FNPT Weld Flange150# (Manway)
Design Standard	Primary steel tank shall be built & tested in accordance with UL58 steel underground storage tanks for flammable & combustible liquids. Fiberglass reinforced plastic jacket shall be manufactured & applied in accordance with Plasteel® specifications & UL1746 part III, corrosion protection systems for underground storage tanks
FRP Thickness(Inches)	1/8"
Stiffener (Qty# or None)	1

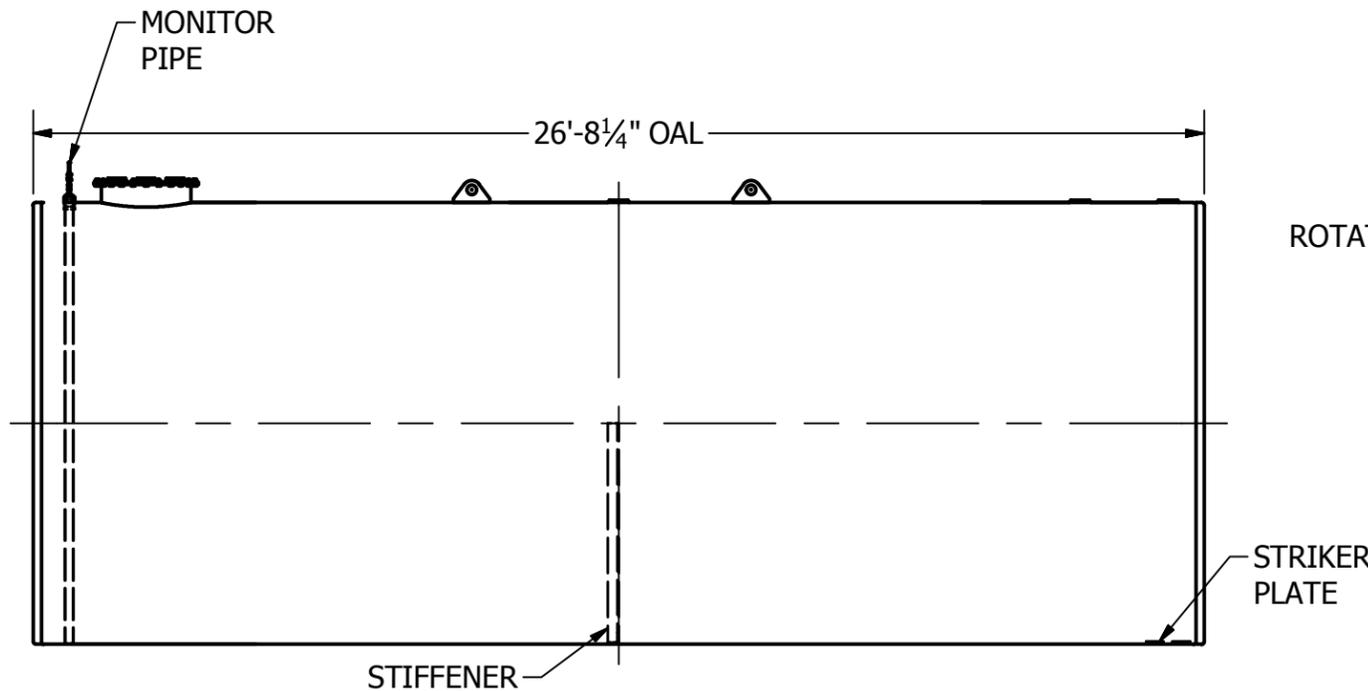

**DRAFT - NOT FOR PRODUCTION**



UNLESS OTHERWISE SPECIFIED:

UNITS = INCHES

TOLERANCE:

LINEAR ±1/8"  
ANGULAR ±1/2"

4401 West Main  
Fargo, ND 58103  
Phone: 701-282-2345  
Fax: 701-282-5516  
TrueNorthSteel.com

DRAWN	DSC	DATE	3/12/2018
CHECKED		DATE	



PART#: 1009-0050  
DESCRIPTION:  
Tank,H,15000,120x312,UL58,FRP,Base

WEIGHT: 12011.775 lbmass

SCALE DO NOT SCALE DRAWING

SHEET 1 OF 1

DATE	REV	APPROVAL DESCRIPTION	PROJ#	BY
3/12/2018	A	APPROVAL	DR-308	DSC
REVISION HISTORY				

THIS DRAWING IS THE SOLE PROPERTY OF TRUENORTH STEEL INC. ANY COPIES/EDITS MADE WITHOUT THE WRITTEN CONSENT OF TRUENORTH STEEL, IS STRICTLY PROHIBITED.